
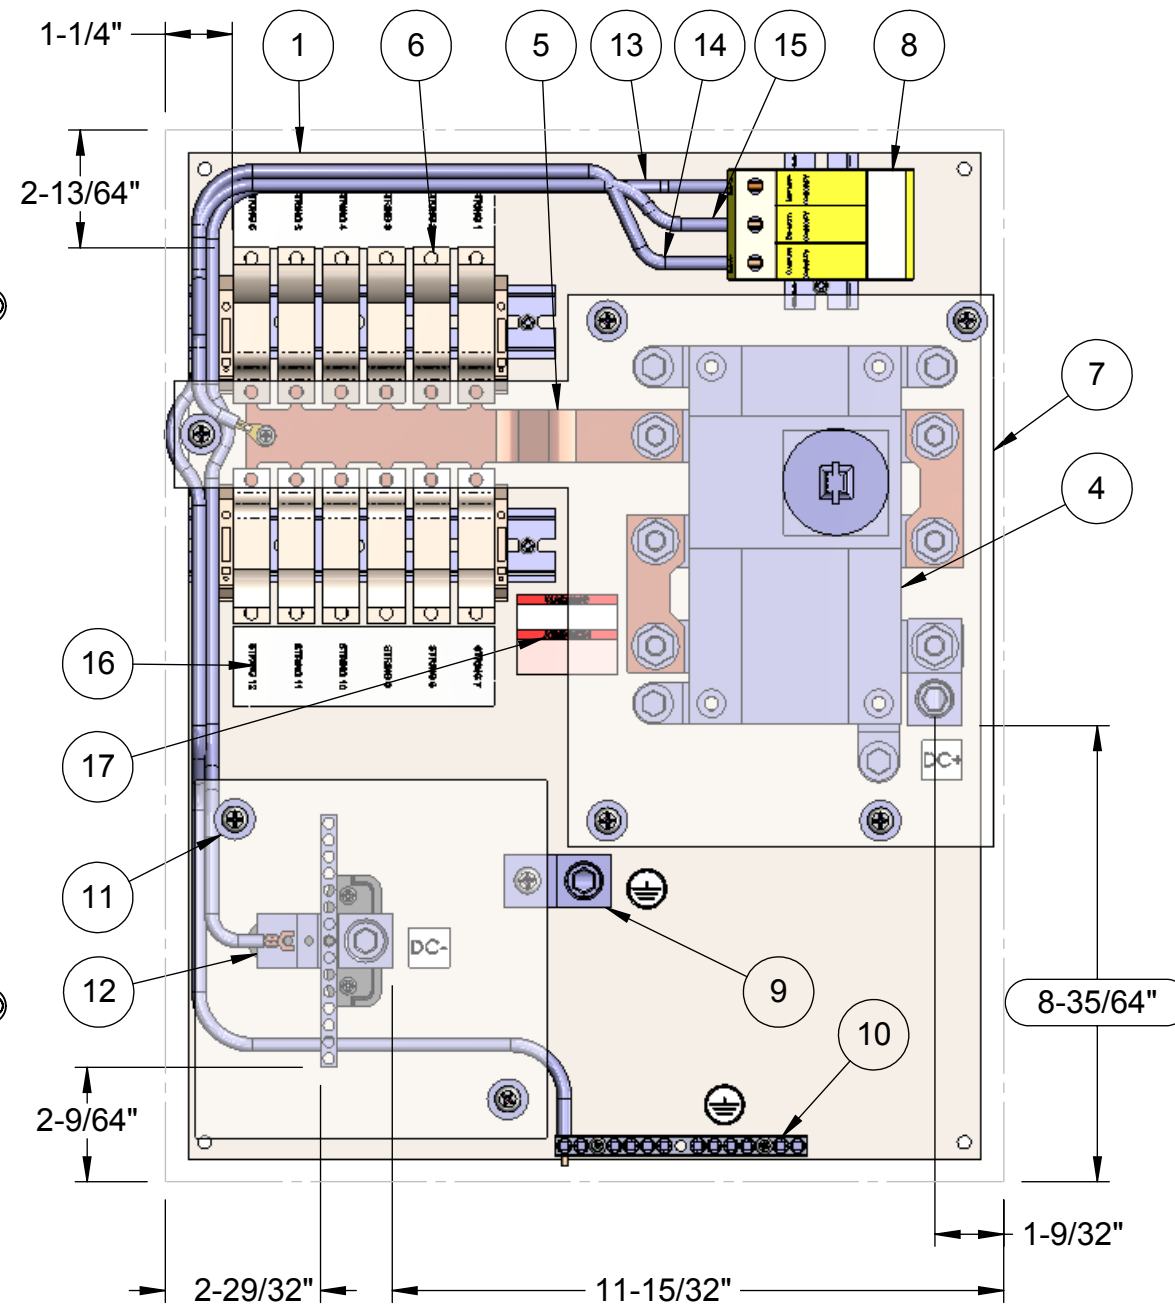


4

3

2

1

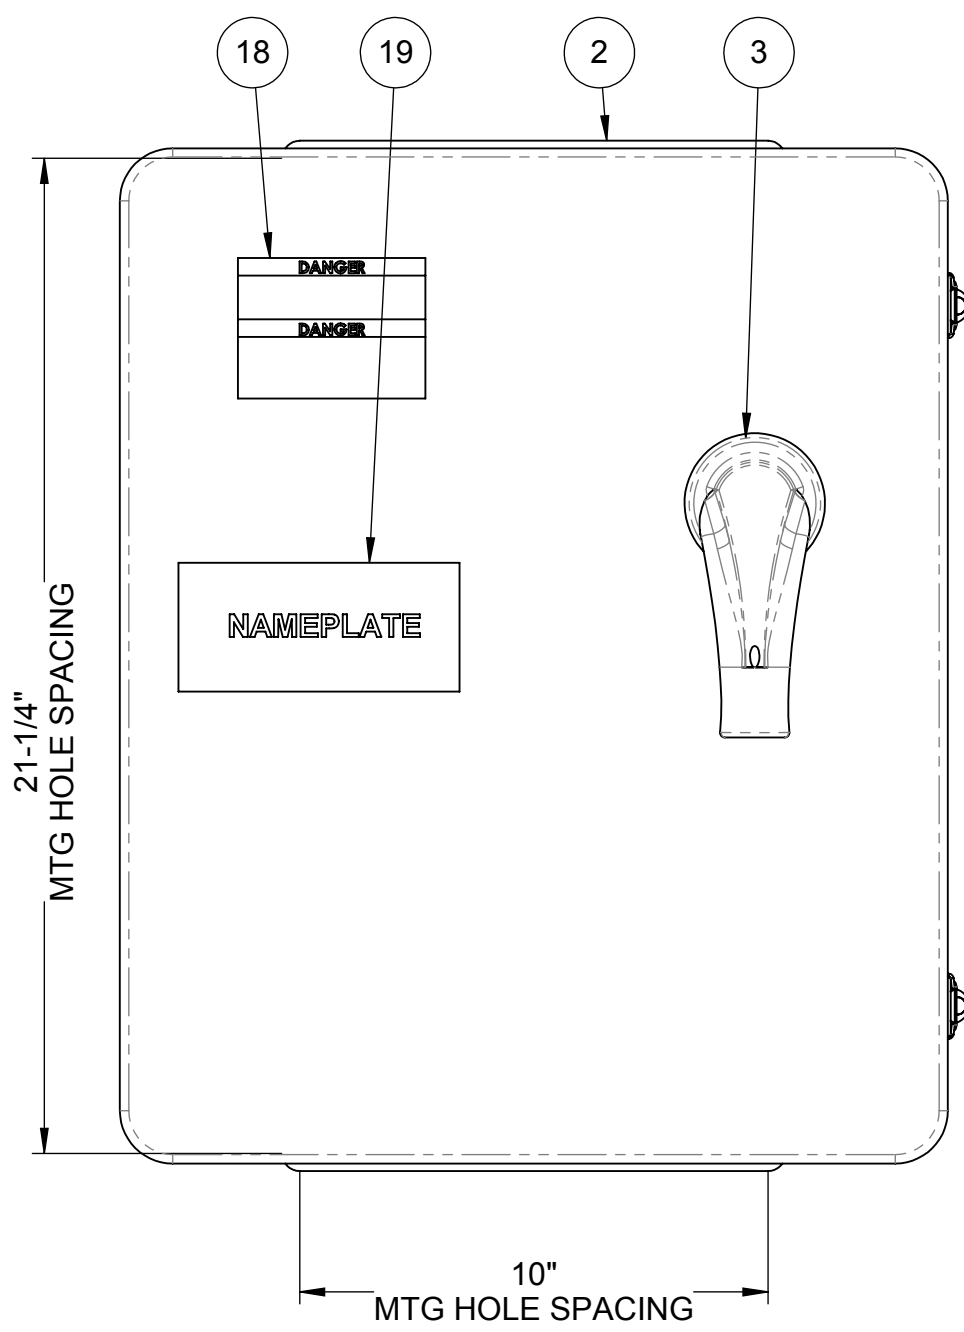

ITEM NO.	QTY.	DESCRIPTION
1	1	Sub Panel 6-12
2	1	Enclosure (20 x 16 x 8)"
3	1	Handle
4	1	600V, 250A Disconnect
5	1	Positive Busbar
6	12	30A Fuseholder
7	2	Lexan
8	1	Surge Protection (OPTIONAL)
9	1	Lug
10	1	Grounding Bar
11	7	Standoff
12	1	Neutral Assembly
13	1	SP WIRE NEG.
14	1	SP WIRE POS.
15	1	SP WIRE GRD.
16	2	String Label
17	1	Fuse Warning Label
18	1	Outside Danger Label
19	1	Nameplate ETL Label

NOTES:

- 8.5" REQ'D FOR WIRE BEND SPACE
- ETL LISTED UNDER REPORT # 100369212CRT-001
- DRAWING SHOWN IS 12 STRING INTEGRAL DISCONNECT MODEL WITH OPTIONAL SURGE PROTECTION. FOR 7 THROUGH 11 STRING CONFIGURATIONS, PRODUCT WILL SHIP WITH FUSE HOLDERS EQUAL TO NUMBER OF STRINGS.

SW_REV_06/2009

A

CCHSY-Template-B

B

DO NOT SCALE DRAWING

A

DIR NUMBER:	10112308314-S/SWD/000/02	
THIS IS PROPERTY OF COOPER CROUSE-HINDS, LLC AND CONTAINS CONFIDENTIAL AND TRADE SECRET INFORMATION. POSSESSION DOES NOT CONVEY ANY RIGHTS TO LOAN, SELL OR DISCLOSE SAID INFORMATION. REPRODUCTION OR USE FOR ANY PURPOSE OTHER THAN WHICH IT WAS SUPPLIED MAY NOT BE MADE WITHOUT EXPRESS WRITTEN PERMISSION OF COOPER CROUSE-HINDS, LLC. THIS DRAWING IS ON LOAN AND IS TO BE RETURNED UPON REQUEST.	TOLERANCES UNLESS OTHERWISE SPECIFIED	
	.X	± .01
	.XX	± .01
	.XXX	± .005
	ANGLES	± 1.5°
	UNLESS OTHERWISE SPECIFIED, ALL PRIMARY DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.	
	ORIGINAL DATE	12/13/2012
	REDRAWN DATE	
	DRAWN BY	WEW
	CHECKED BY	SJN
	APPROVED BY	SJN
	APPROVED BY	
	PATT. I.B.	IB

COOPER Crouse-Hinds

TITLE
CCBFXX DS250 SP

FIRST MADE FOR Solar Combiner Box

SIZE	CODE IDENT. NO.	REV.
B	12308314-S	01
SCALE 1:8	SHEET 1 OF 1	

4

3

2

1